



PLAN VIEW

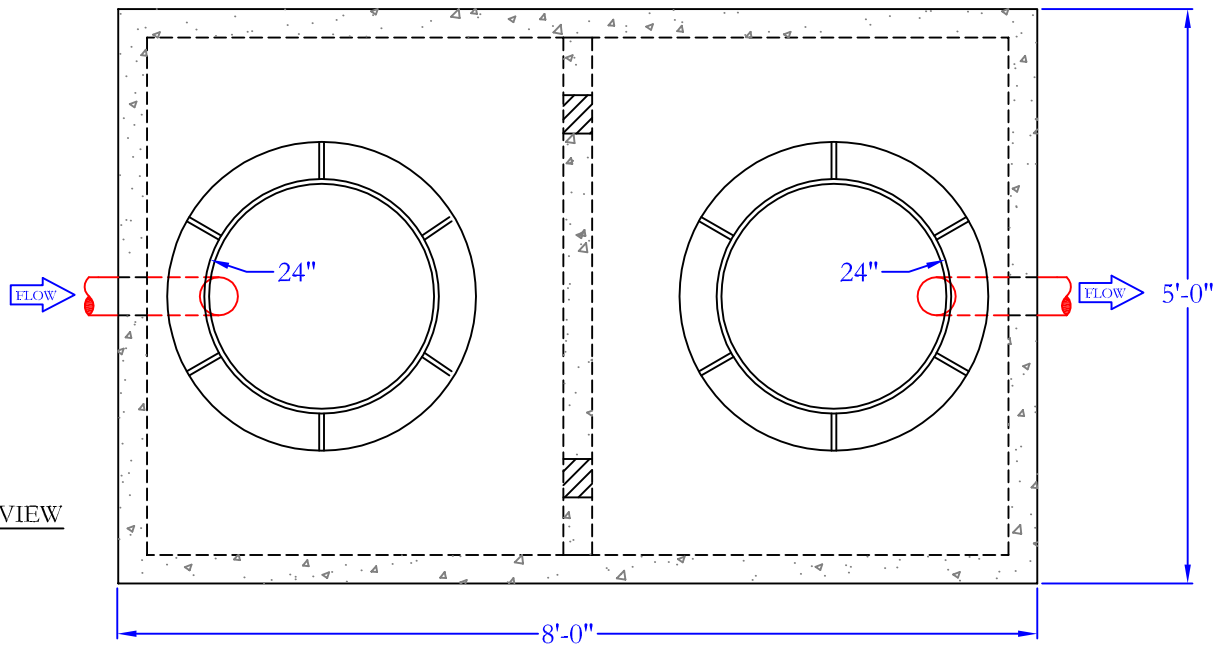

ELEVATION

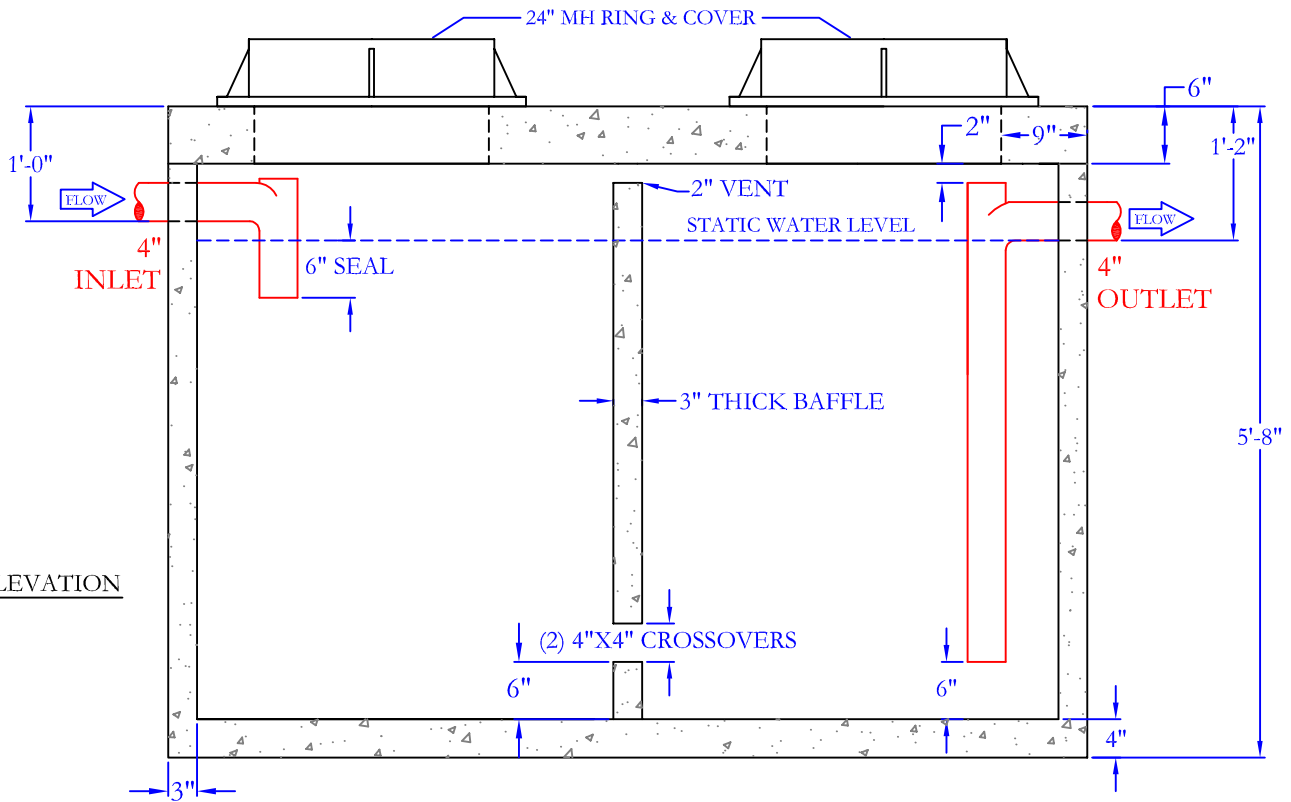

SPECIFICATIONS:

CONCRETE: Class 1 concrete with design strength of 4500 PSI at 28 days. Unit is of monolithic construction at floor and first stage of wall. Baffle is slide in type.

REINFORCEMENT: Grade 60 reinforced with steel rebar conforming to ASTM A-615 on required centers.

C.I. CASTINGS: Cast Iron Ring & Cover shall be nominal 24" and traffic duty

ENGINEERING DATA:

Minimum Liquid Capacity : 141 cubic feet or 1050 Gallons
 Minimum Depth : 4'-2" Liquid Level

Field excavation and preparation shall be completed prior to delivery of grease trap. Use dimensional data as shown.

1000 GALLON GREASE TRAP

STANDARD DIAGRAM

SCALE: NOT TO SCALE

DATE: 2/16/06

28021 Coker-Vail Road
 Phone (225) 567 - 2700

Holden, LA 70744
 Fax (225) 567 - 3089

www.gaineyconcrete.com

